


# DETAIL "B" - TYPICAL CABLE LABELING METHOD

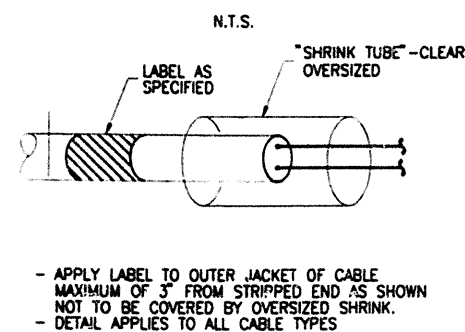

## CIRCUIT DESIGNATION:

ALD - (TENANT NAME) CABLE IDENTIFICATION TAG; (BRADY LABEL #WML-305-292 O.A.E.)

OR TEL-SJ

TYPE OF CIRCUIT: (TENANT NAME)

ALD - ALD LOOP DEVICE CIRCUIT. SJ - STAND PIPE PHONE JACK CIRCUIT.

TEL - TELEPHONE CIRCUIT.

# TERMINATION LEGEND

FC-CS2-ALD-1

TB2

+ (R) 2

TERMINAL BLOCK STRIP NUMBER 2

TERMINAL BLOCK #2

+ INDICATES POSITIVE POLARITY

(R) INDICATES RED WIRE


(W) INDICATES WHITE WIRE

(B) INDICATES NEGATIVE POLARITY

S INDICATES BLACK WIRE

2 INDICATES SHIELD/DRAIN WIRE

# DETAIL "A" - TYPICAL SHIELD/DRAIN INSULATING METHOD

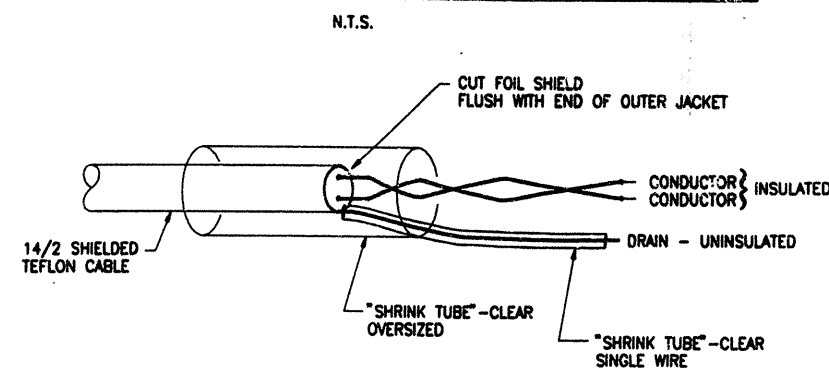

## NOTES:

- FOR LEGEND AND GENERAL NOTES SEE DRAWING E-1.
- ALL SHIELD CONDUCTOR MUST BE ISOLATED FROM GROUND. APPROVED SHRINK TUBING MUST BE USED ON ALL DRAIN CONDUCTORS.
- ALL WIRING SHALL BE FREE OF GROUND FAULTS, OPENS, SHORTS AND STRAY VOLTAGES.
- ALL WORK SHALL BE DONE IN THE PRESENCE AND UNDER THE DIRECT SUPERVISION OF THE ENGINEER.

Sheet 35 Of 40

THE PORT AUTHORITY OF NY & NJ

Peter K. Schwab  
ENGINEERING PROGRAM MANAGER  
WORLD TRADE CENTER  
CHIEF ELECTRICAL ENGINEER

Engineering Program Manager

03/16/01 Drawing of Record  
No. Date Revision Approved

Engineering Department  
Design Division  
The World Trade Center

CONCOURSE FIRE ALARM SYSTEM  
TELEPHONE AND ALD LOOP DEVICES  
ELECTRICAL  
TSC BLOCK WIRING DIAGRAM  
SHEET 12  
(TSC-CS-5B & ATC-CS-5B)

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

S. FELDSTEIN F. DEVITA J. W.  
Designed by Drawn by Checked by

Date MARCH 18, 1998 Scale NONE

Contract Number Drawing Number

WTC-857.092 E-33  
SUPPLEMENT NO.1

FILE NAME: O:\CW2-857.092\ALD SUPP TSCWHE.CS.E-33.DWG 3/19/1998 HECTOR ALMARIO

